



PLAN VIEW

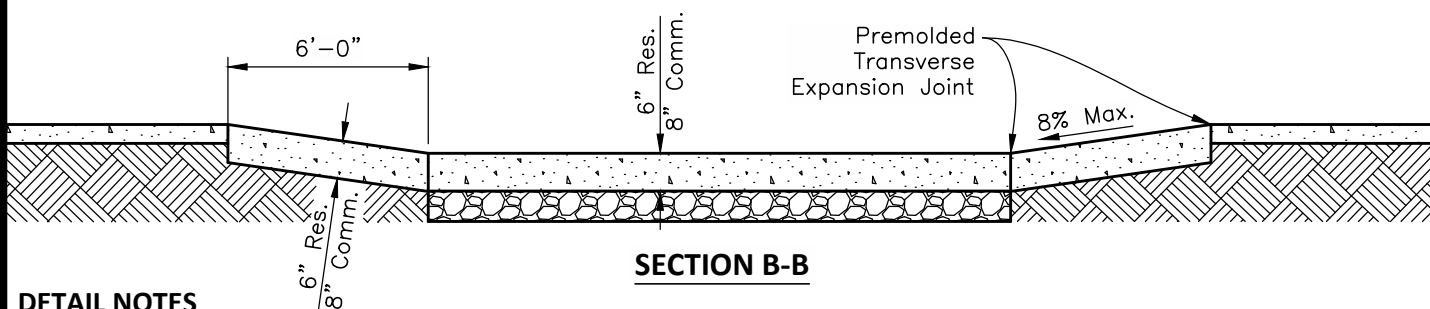

SECTION B-B

DETAIL NOTES

1. Concrete for driveway shall be ODOT Class "S", Air Entrained Concrete w/Limestone Aggregate and 715 lbs. of cement per C.Y., maximum 4" slump, broom finish with edge trowel. No Fly Ash or GGBFS in concrete. Contraction joints shown, sawn not less than 2" deep.
2. Contractor is responsible for protecting adjacent driveway, sidewalk, underdrain, and street lighting cable and replacement of same if damaged due to Contractor's work.
3. Sidewalks shall be constructed according to C-GC-46A.
4. All joints and edges are to be tooled.
5. Any existing castings or valve boxes in driveway approach shall be adjusted to grade.
6. Contractor shall apply a Cure & Seal compound, as approved by the City, to finished concrete.

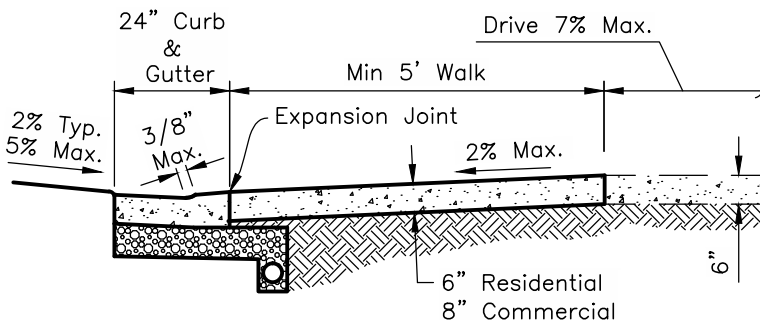

SECTION A-A

Approved By:

 City Engineer, EMH&T Inc.

 City Service Director

STANDARD DIMENSIONS
 FOR
**STANDARD DRIVE WITH
 SIDEWALK ADJACENT TO
 CURB ON PUBLIC R/W**

**CITY OF
 GROVE CITY, OHIO**

STANDARD
 CONSTRUCTION DRAWING

Revised

Rev
 February 2016

Drawing No.

C-GC-46B